

CO₂ Component Description




A UTC Fire & Security Company

Flex Hose - 1/2 in.

Effective: July 2011

K-81-1080

P/N 81-252184-000

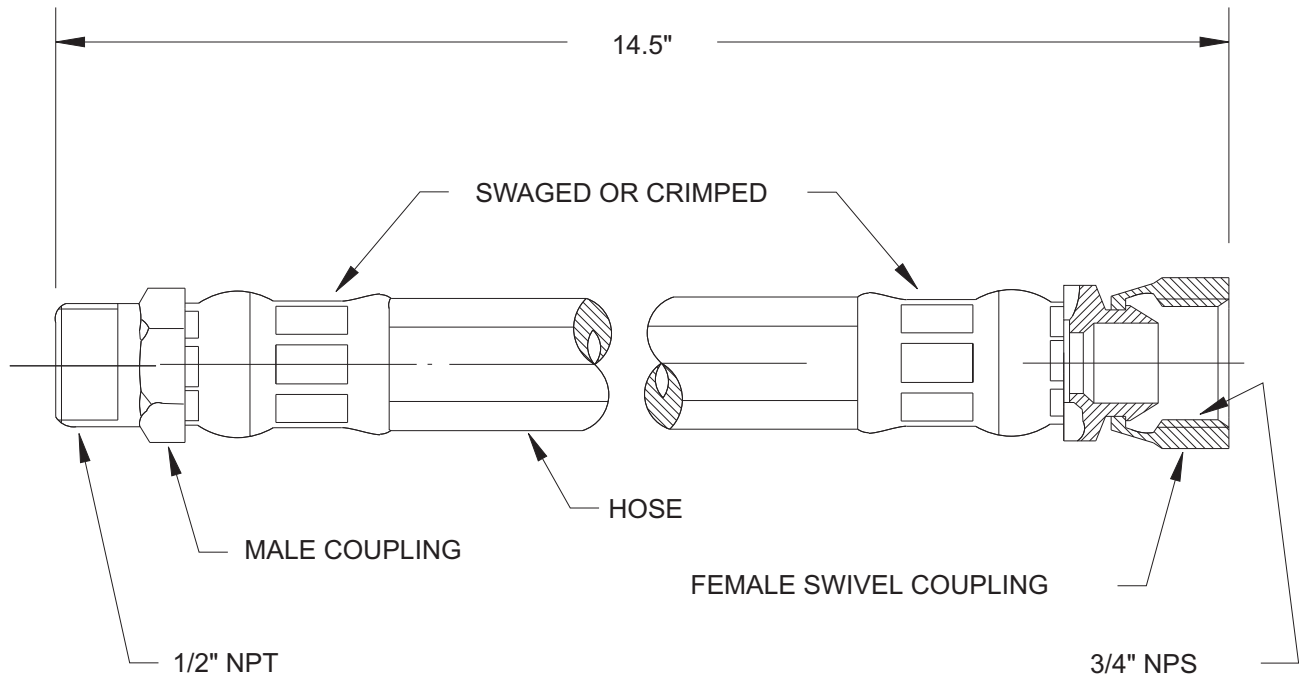

MINIMUM BURST PRESSURE: 6000 PSI (414 BAR)

HYDRO TEST PRESSURE: 1500 PSI (103 BAR)

TEMPERATURE RATING: -40°F TO +250°F (-40°C TO 121°C)

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly. If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. Telephone: (508) 881-2000.