

CO₂ Component Description




A UTC Fire & Security Company

4-inch Stop (Directional) Valve

Effective: February 2007

K-81-5150

P/N: 890208

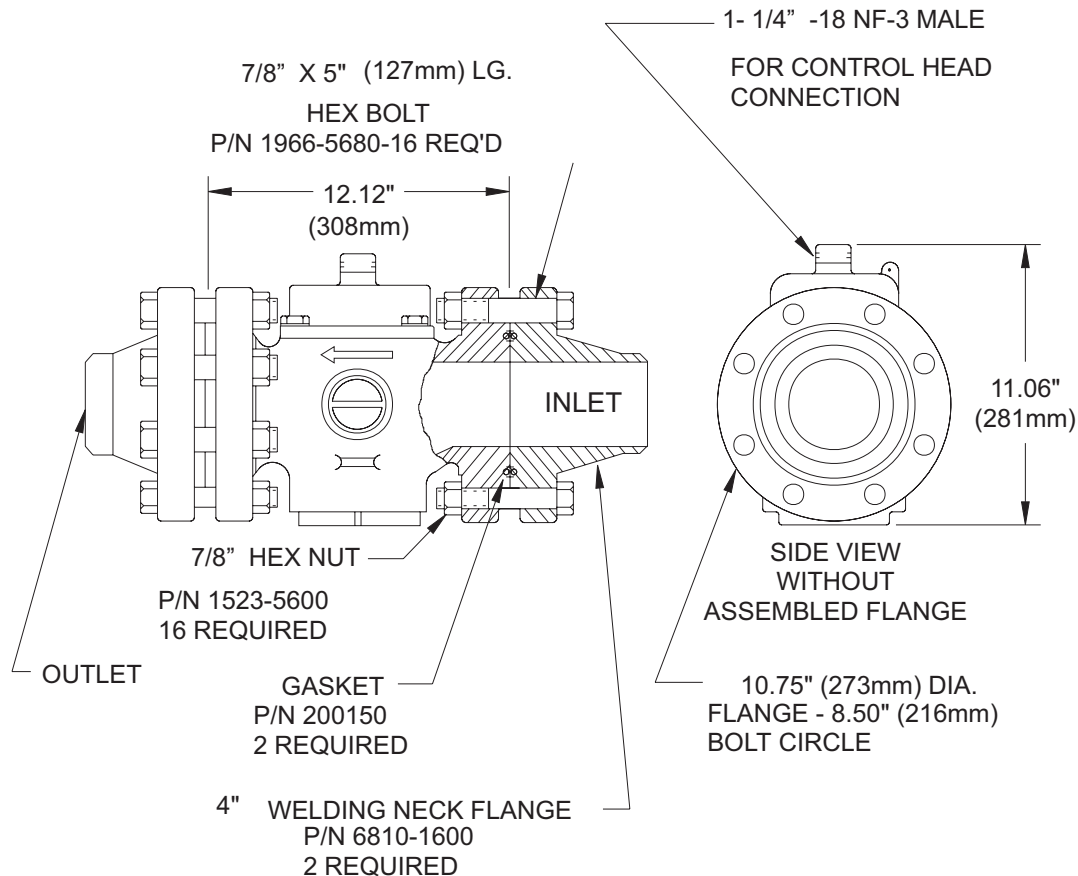

MATERIALS

VALVE BODY: BRASS

GASKET: IRON

FLANGES, BOLTS, & NUTS: STEEL

Note: VALVE MUST BE INSTALLED WITH ARROW
POINTING IN DIRECTION OF FLOW.

Operating Pressure (@70°F): 850 PSI (58 BAR)
Test Pressure: 2250 PSI (155 BAR)
Burst Pressure: 6000 PSI (413 BAR)

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly.
If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. Telephone: (508) 881-2000.