



Effective: March 2003

XV Control System

For Fire Suppression Applications

***THANK YOU - For your purchase of the NEW
Control System!***

Inside this pamphlet you will find an illustration depicting one of many possible system designs which can be configured with this unique control system.

Kidde Fire Systems ... for all your fire suppression needs.

This literature is provided for informational purposes only; KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly.
If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. Telephone: (508) 881-2000




400 Main Street
Ashland, MA 01721 USA
Tel: (508) 881-2000
Fax: (508) 881-8920
<http://www.kiddefiresystems.com>



The New Kidde Fire Systems XV Control System

The diagram shows a horizontal dashed line representing a detection line. On the left end, there is a small icon of a detector. Along the line, there are several small vertical tick marks. On the right end, there is a bracket labeled "Detectors" and an arrow pointing to the right labeled "Terminus for Detectors".

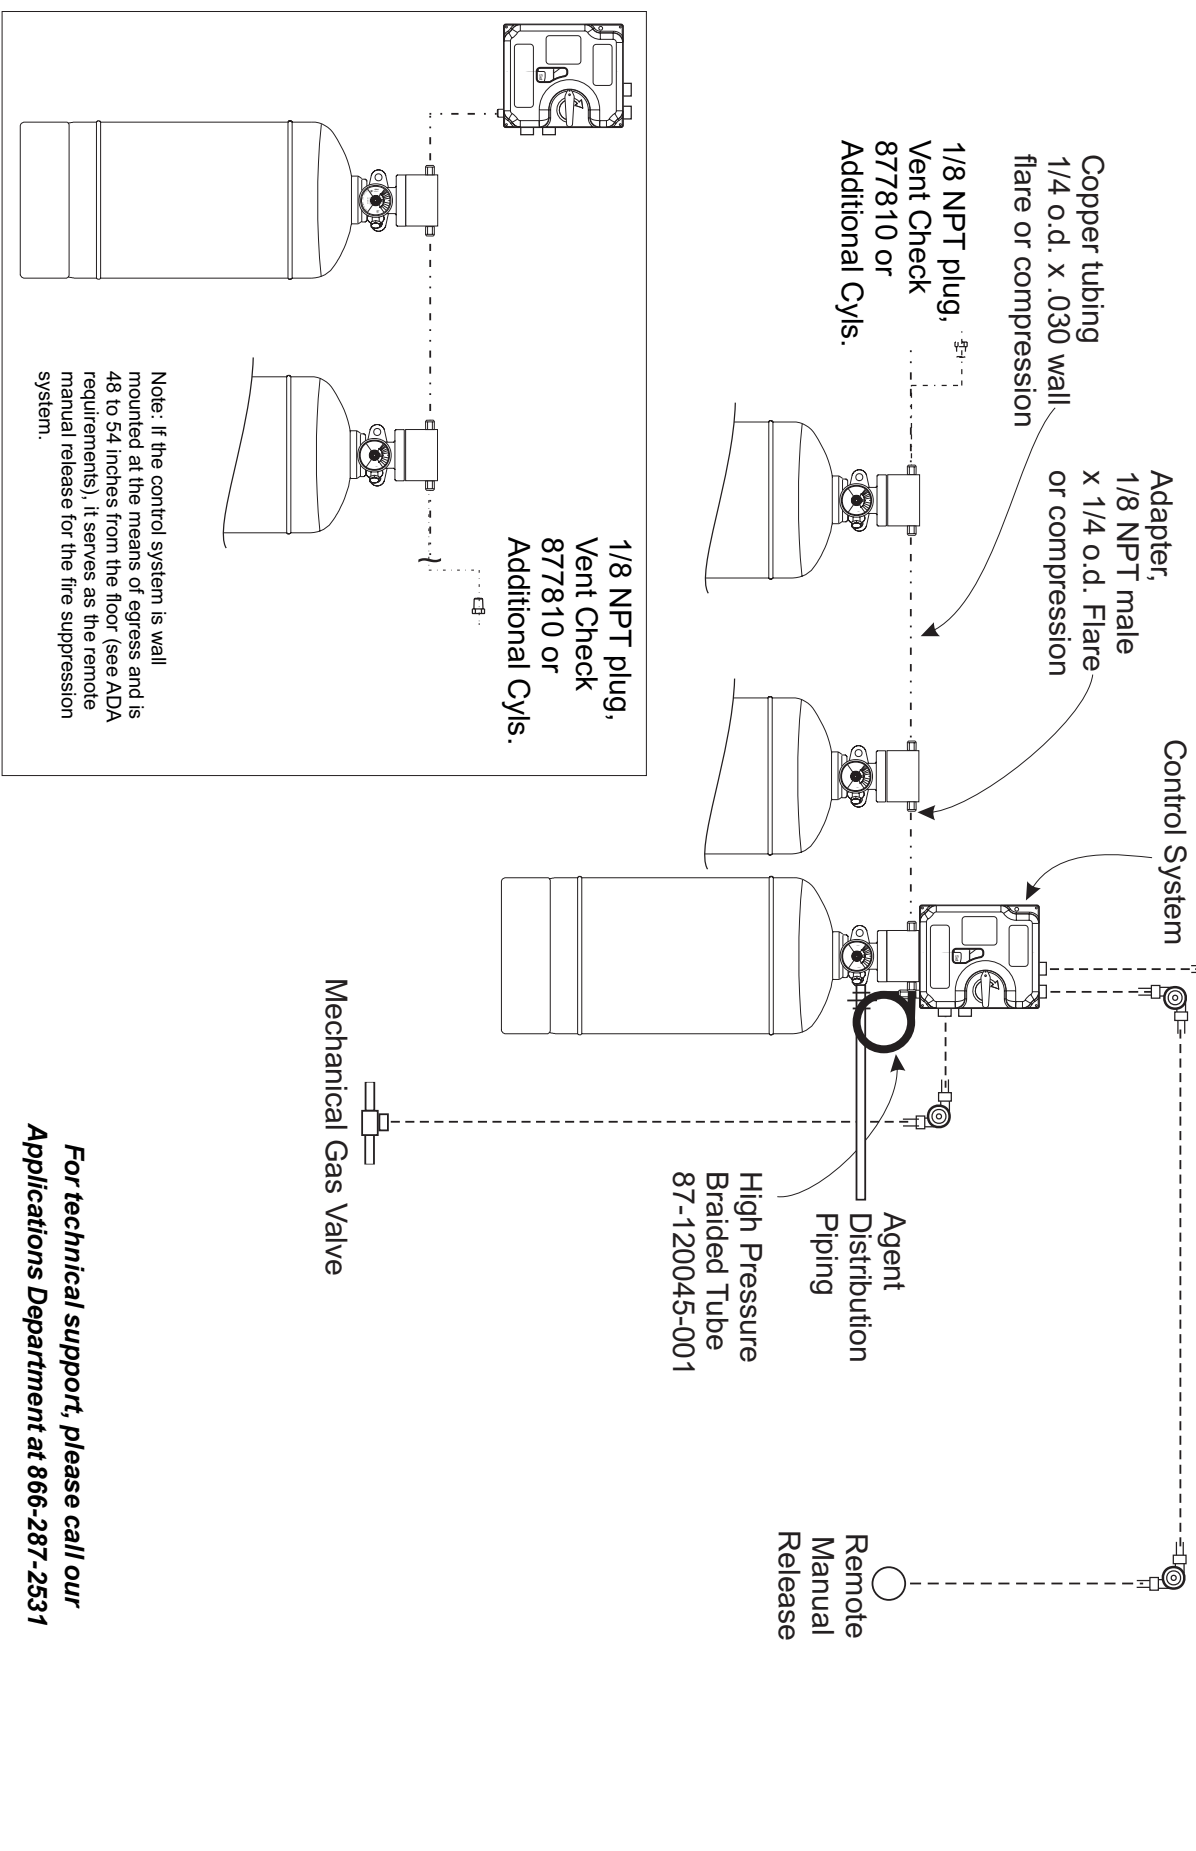

For technical support, please call our Applications Department at 866-287-2531