

Kidde Fire Systems

Natura™ Inert Gas System

Component Description



Effective: April 2021
K-38-3580 Rev AC


Distance Pipe

FEATURES

- For Approvals, see the “COMPATIBILITY” table.
- *REACH and RoHS compliant*

DESCRIPTION

Use the distance pipe as a spacer when the front row of a cylinder rack has less cylinders than the rear row of the rack. Distance Pipes are only used on multi-row systems.

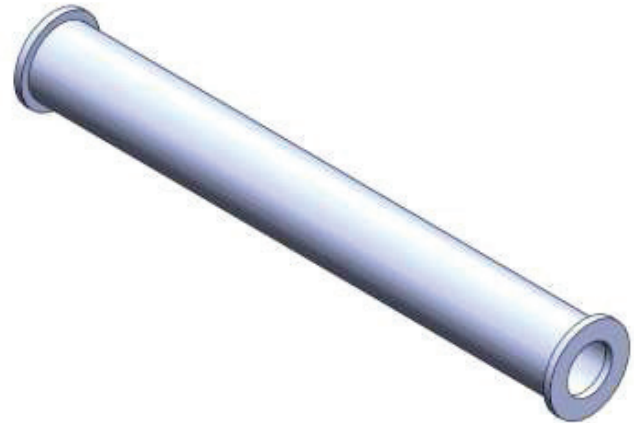


ORDERING INFORMATION

Part Number	Description
03-8331-0000	Distance Pipe 3/4 in. + Washers 80L
03-8331-0140	Distance Pipe 3/4 in. + Washers 140L

COMPATIBILITY

Series	DIOM P/N	Approvals*
Natura™ Inert Gas System	06-237619-001	FM, UL
* For additional listings, contact Kidde Fire Systems		

DISTANCE PIPE INSTALLATION LOCATION

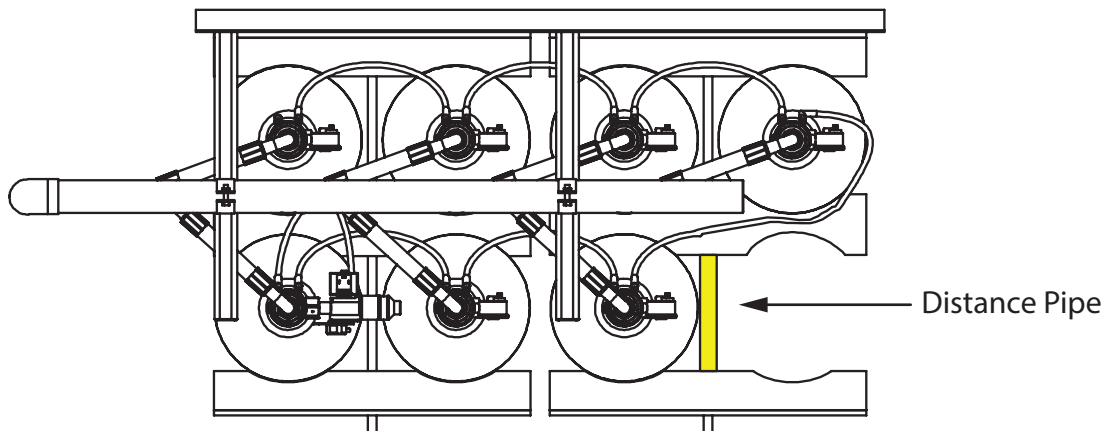

EXPORT INFORMATION (USA)

Jurisdiction: EAR
Classification: EAR99

This document contains technical data subject to the EAR.

All trademarks are property of their respective owners.
©2021 Carrier

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. believes this data to be accurate, but it is published and presented without any guarantee or warranty whatsoever. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. Product features specified are only applicable when the fire suppression system is correctly designed, installed, maintained and serviced by trained, authorized Kidde Fire Systems distributors as per the applicable design, installation, operation, and maintenance manuals. If you need more information on this product, or if you have a particular problem or question, contact: KIDDE-FENWAL, INC., Ashland, MA 01721 USA, Telephone: (508) 881-2000.

Kidde Fire Systems
400 Main Street
Ashland, MA 01721
Ph: 508.881.2000
Fax: 508.881.8920
kiddefiresystems.com