

Kidde Fire Systems

Natura™ Inert Gas System

Component Description



Effective: April 2021
K-38-2110 Rev AC

Release Unit

FEATURES

- For Approvals, see the “COMPATIBILITY” table.
- REACH and RoHS compliant

DESCRIPTION

Release units connect to the gauge port of the primary cylinder and are used to release the agent to the piping system. Release units can be electric operated only or manual/electric. Depending on the control panel needs, release units can be purchased with pressure gauges using normally open or normally closed contacts (when under pressure).


Release units that include manual operation have a tamper proof seal on the operation pin. Replacement seals are included in the Release Unit Service kit, P/N: 38-400001-010.

SOLENOID SPECIFICATIONS

- Operating Voltage: 24 VDC 18W
- Current Draw: 0.75 Amps

ORDERING INFORMATION

Part Number	Pressure Rating	Operation	Contact
38-400001-001	200 Bar	Manual/ Electric	Normally Open
38-400001-003	300 Bar	Manual/ Electric	Normally Open
*Not for use on for FM Approved and UL Listed systems, for LPCB Listed systems only			

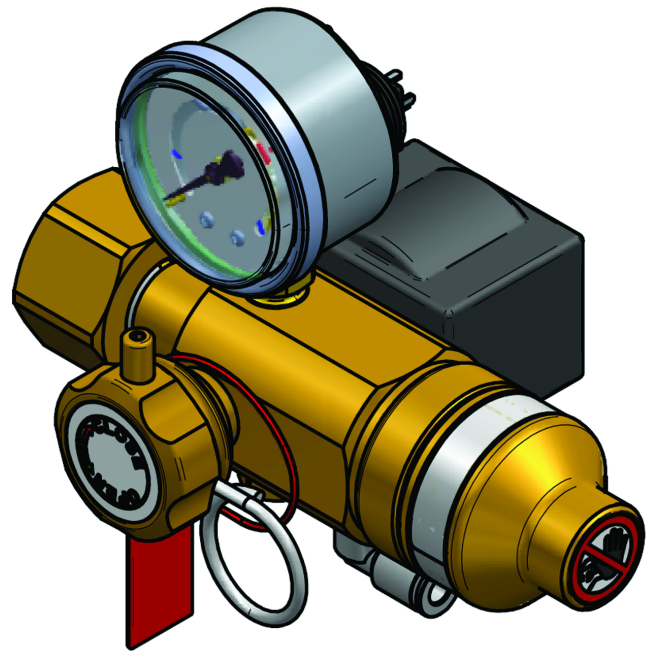

COMPATIBILITY

Series	DIOM P/N	Approvals*
Natura™ Inert Gas System	06-237619-001	FM, UL
Natura™ Inert Gas System	06-237598-001	LPCB
* For additional listings, contact Kidde Fire Systems		

EXPORT INFORMATION (USA)

Jurisdiction: EAR
Classification: EAR99

This document contains technical data subject to the EAR.

All trademarks are property of their respective owners.
©2021 Carrier

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. believes this data to be accurate, but it is published and presented without any guarantee or warranty whatsoever. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. Product features specified are only applicable when the fire suppression system is correctly designed, installed, maintained and serviced by trained, authorized Kidde Fire Systems distributors as per the applicable design, installation, operation, and maintenance manuals. If you need more information on this product, or if you have a particular problem or question, contact: KIDDE-FENWAL, INC., Ashland, MA 01721 USA, Telephone: (508) 881-2000.

Kidde Fire Systems
400 Main Street
Ashland, MA 01721
Ph: 508.881.2000
Fax: 508.881.8920
kiddefiresystems.com